



# Switchyard

Site North

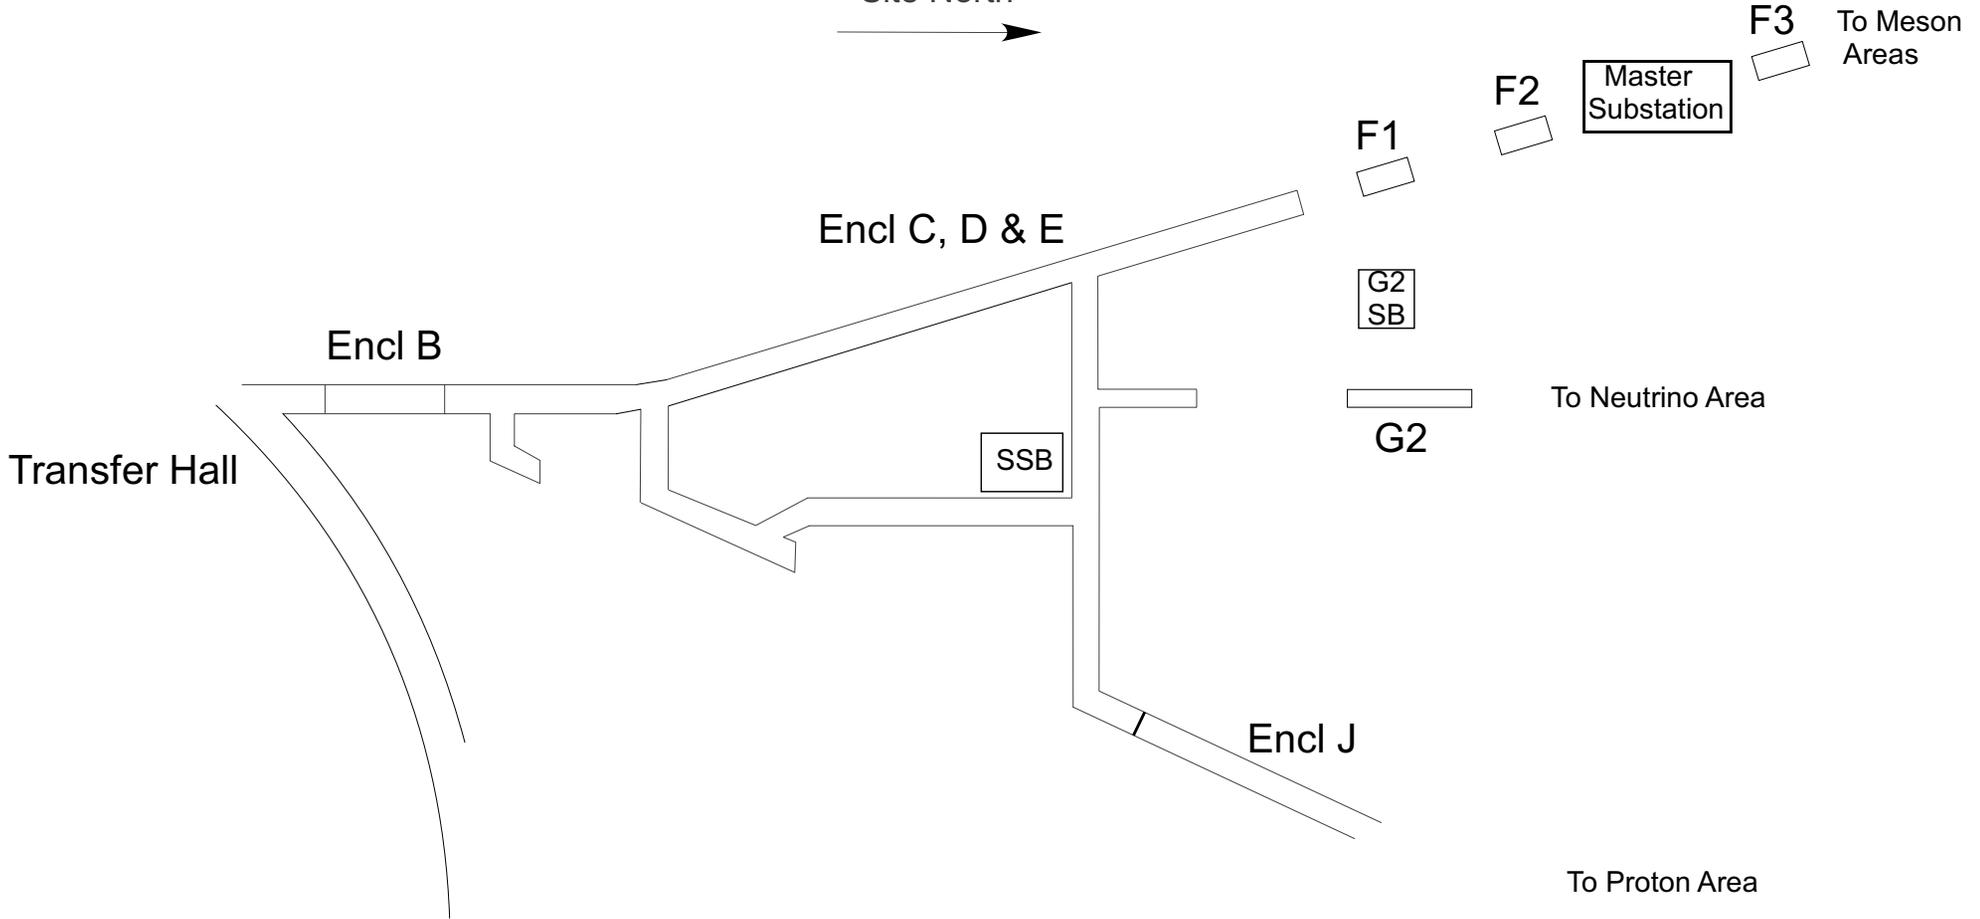

# Switchyard Enclosure B

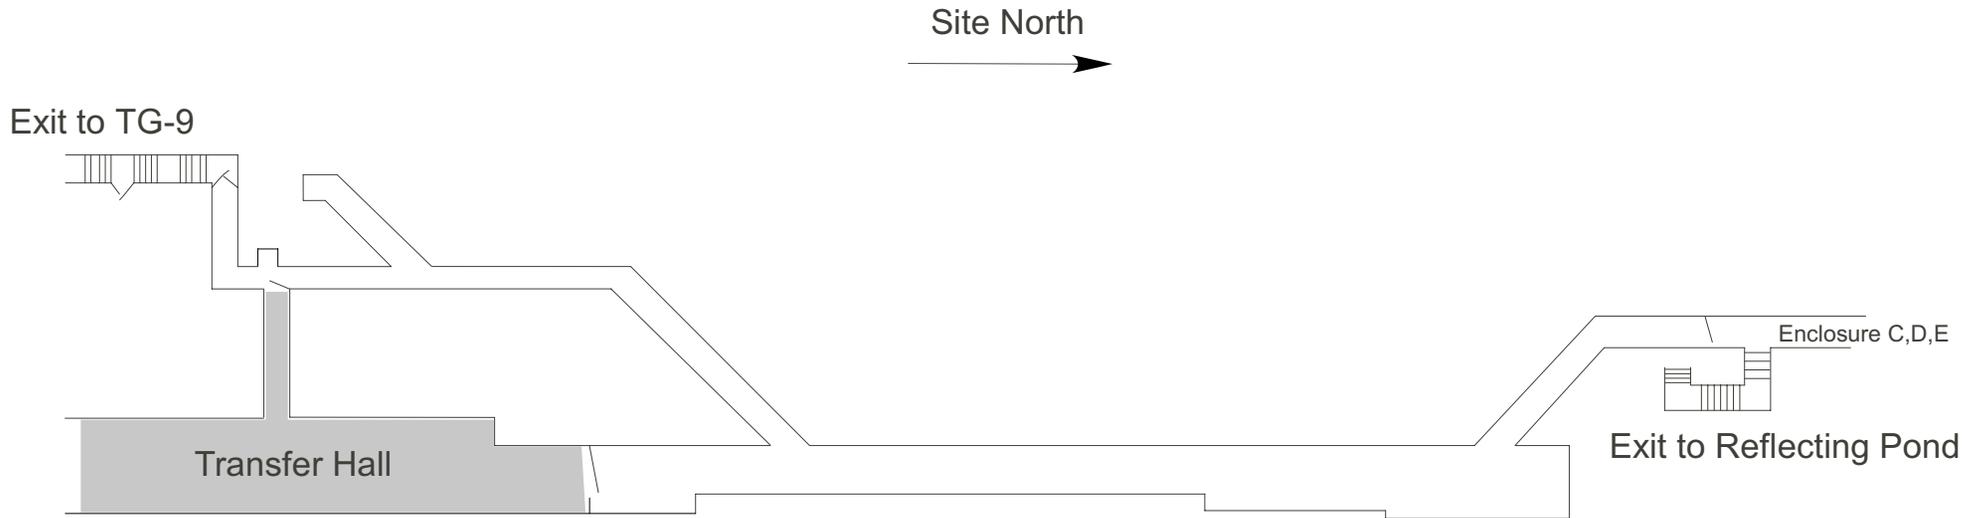


**Notes:**

Requires "Enclosure B" key to access.

ODH 1

# Switchyard Enclosure C, D & E

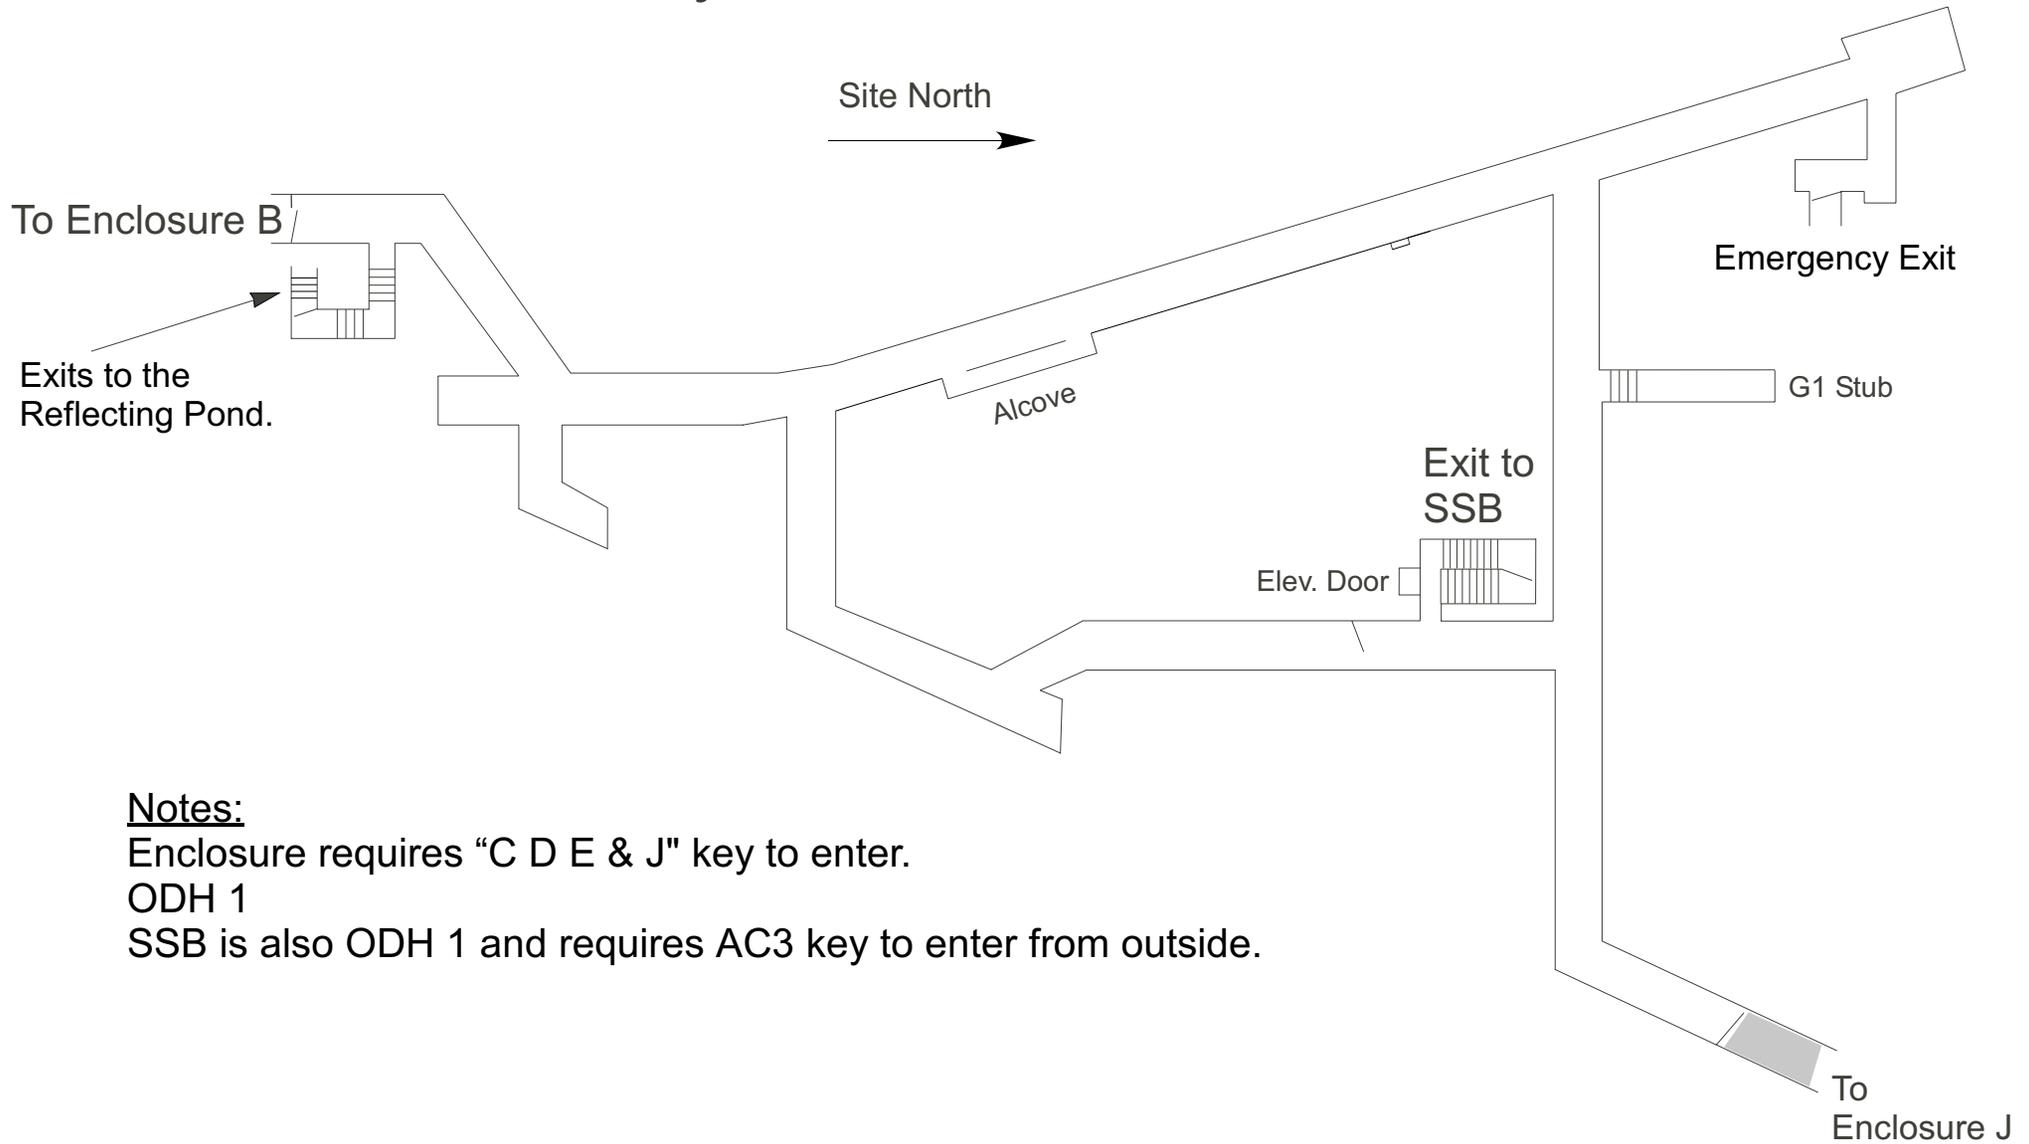

**Notes:**


Enclosure requires "C D E & J" key to enter.

ODH 1

SSB is also ODH 1 and requires AC3 key to enter from outside.

# Switchyard Enclosure F1 (F1 Manhole)

Site North  
→

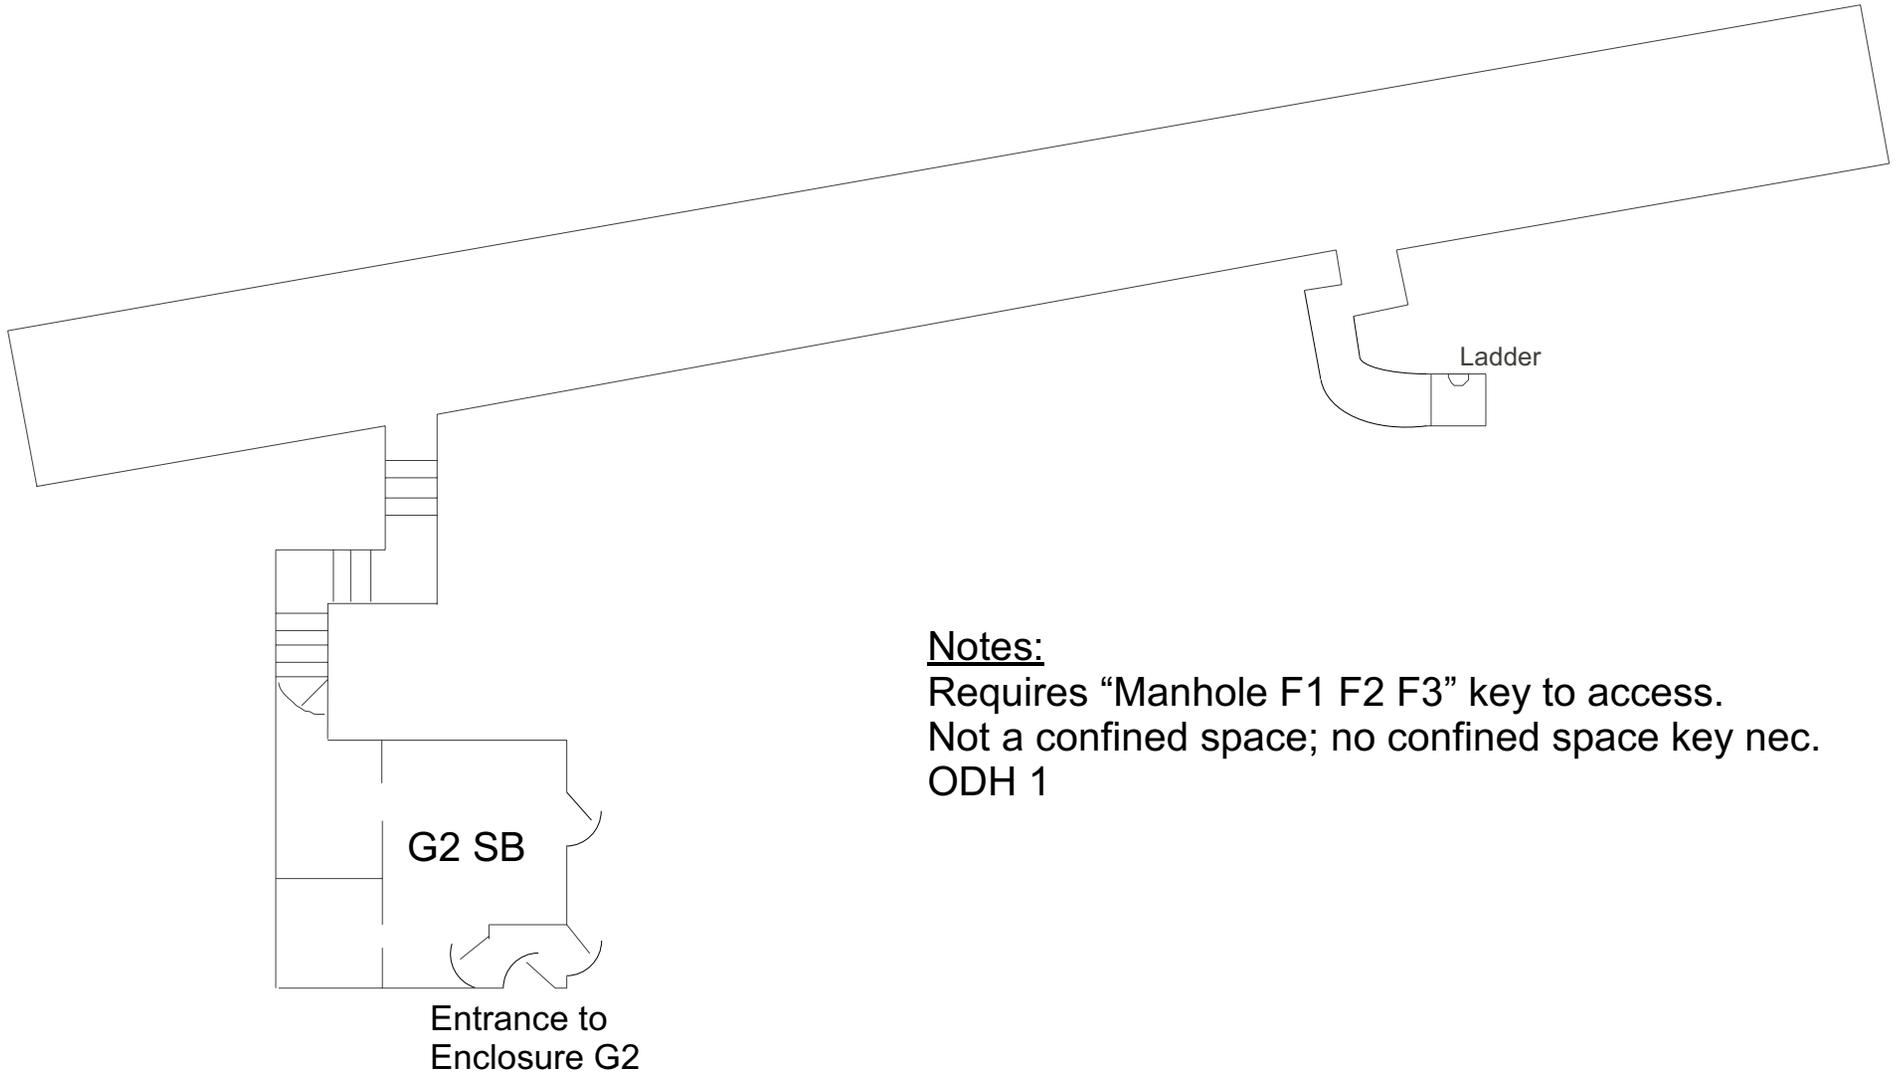


Notes:

Requires "Manhole F1 F2 F3" key to access.  
Not a confined space; no confined space key nec.  
ODH 1

March 2007

# Switchyard F2 & F3 Manholes

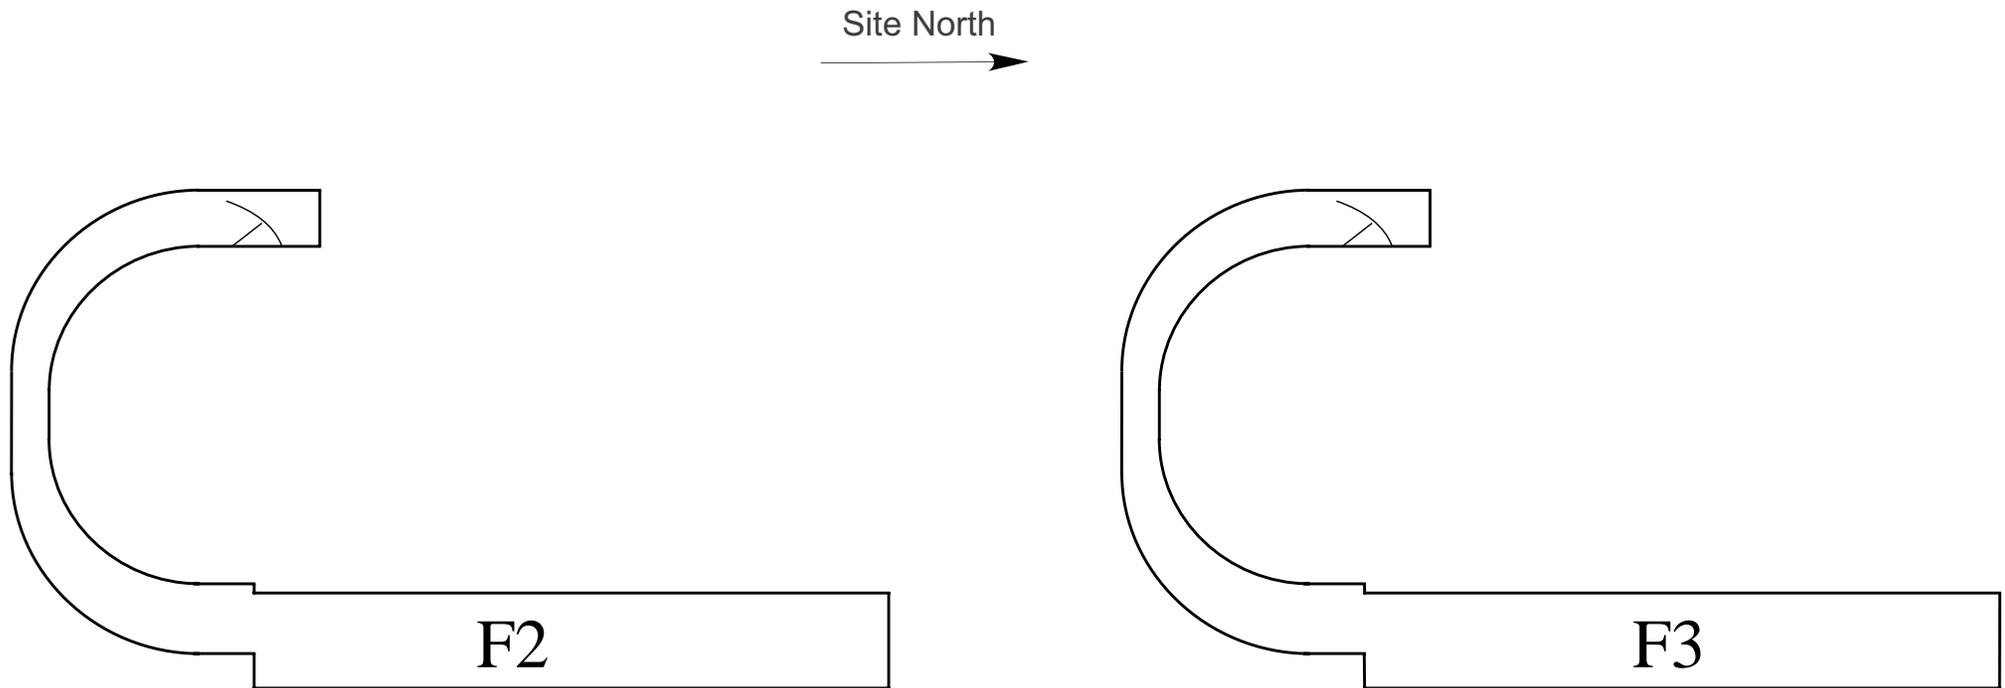

## Notes:

F2 is located east of the Master Substation.


F3 is on the west side of the Meson berm, south of M01.

Both require “Manhole F1 F2 F3” key to access.

Both are confined spaces & require confined space key to access.

Both are ODH 1.

# Switchyard Enclosure G2

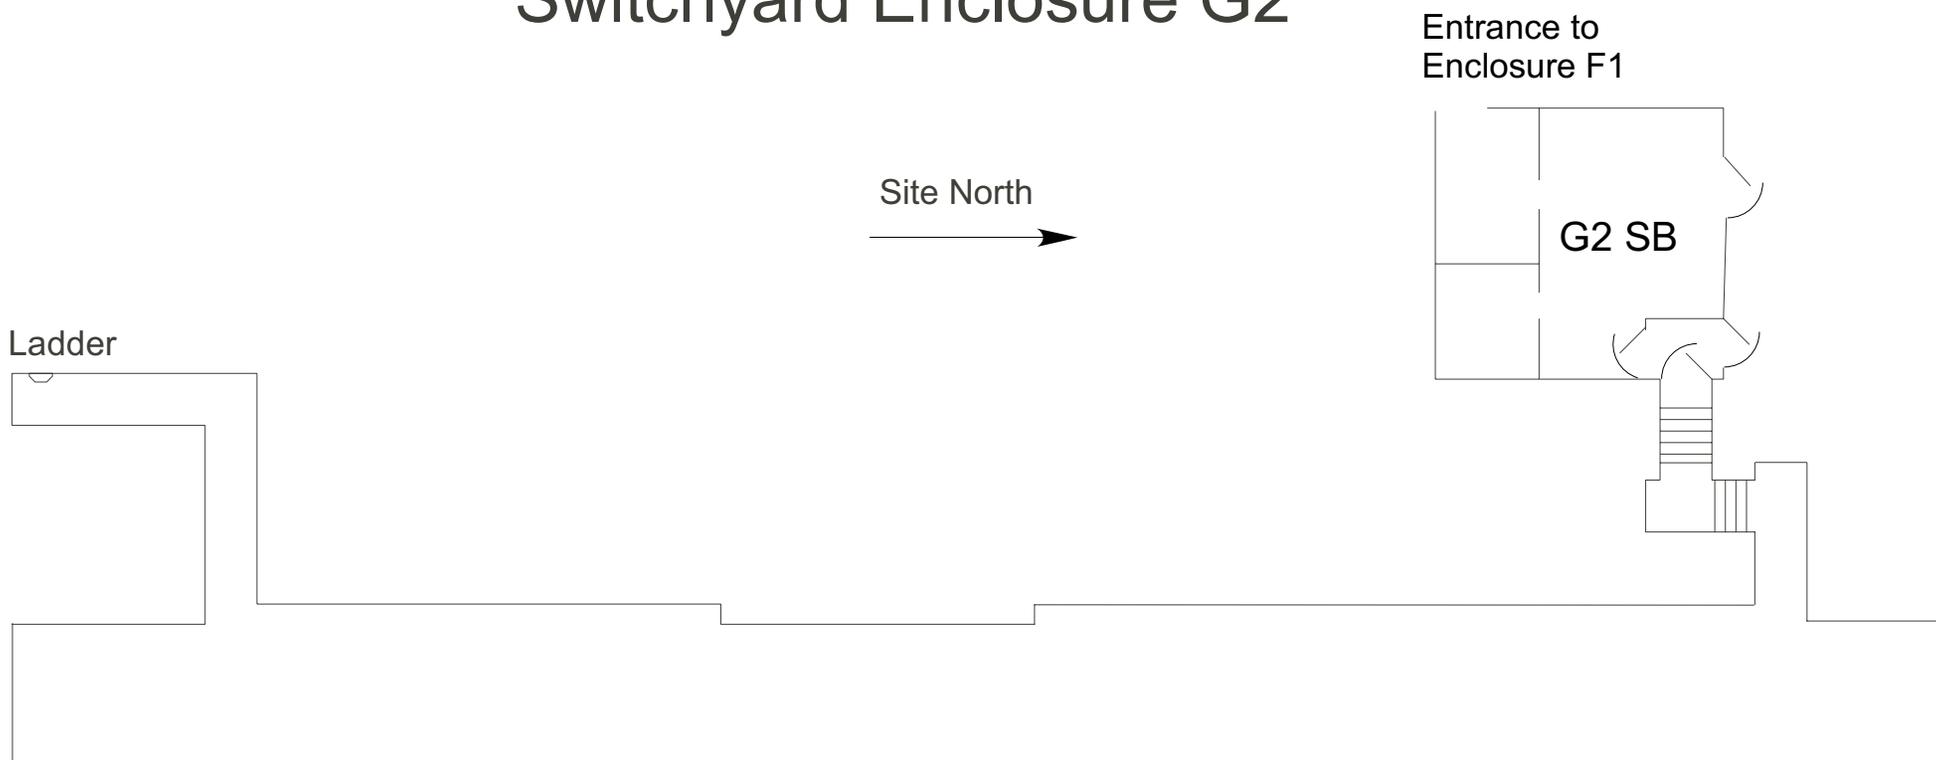

Notes:

Requires "Encl G2" key to enter  
Contains no operational devices except vacuum  
ODH 1

# Switchyard Enclosure J

Site North  
→

From  
Enclosure C,D,E

Emergency Exit

Exit to PS1 SB



## Notes:

Requires "Proton Area" key to enter.  
Contains no operational devices.